


NOTES:

1. SPARE CHANNELS WHEN NOT IN USE - SLIDE SWITCH INTO THE UP POSITION
2. ALARM SLIDE SWITCH - TO BE POSITIONED AS SHOWN ON COMMISSIONING
3. INCOMING SUPPLY IS SINGLE PHASE AC IN ACCORDANCE WITH CURRENT LPC RULES.

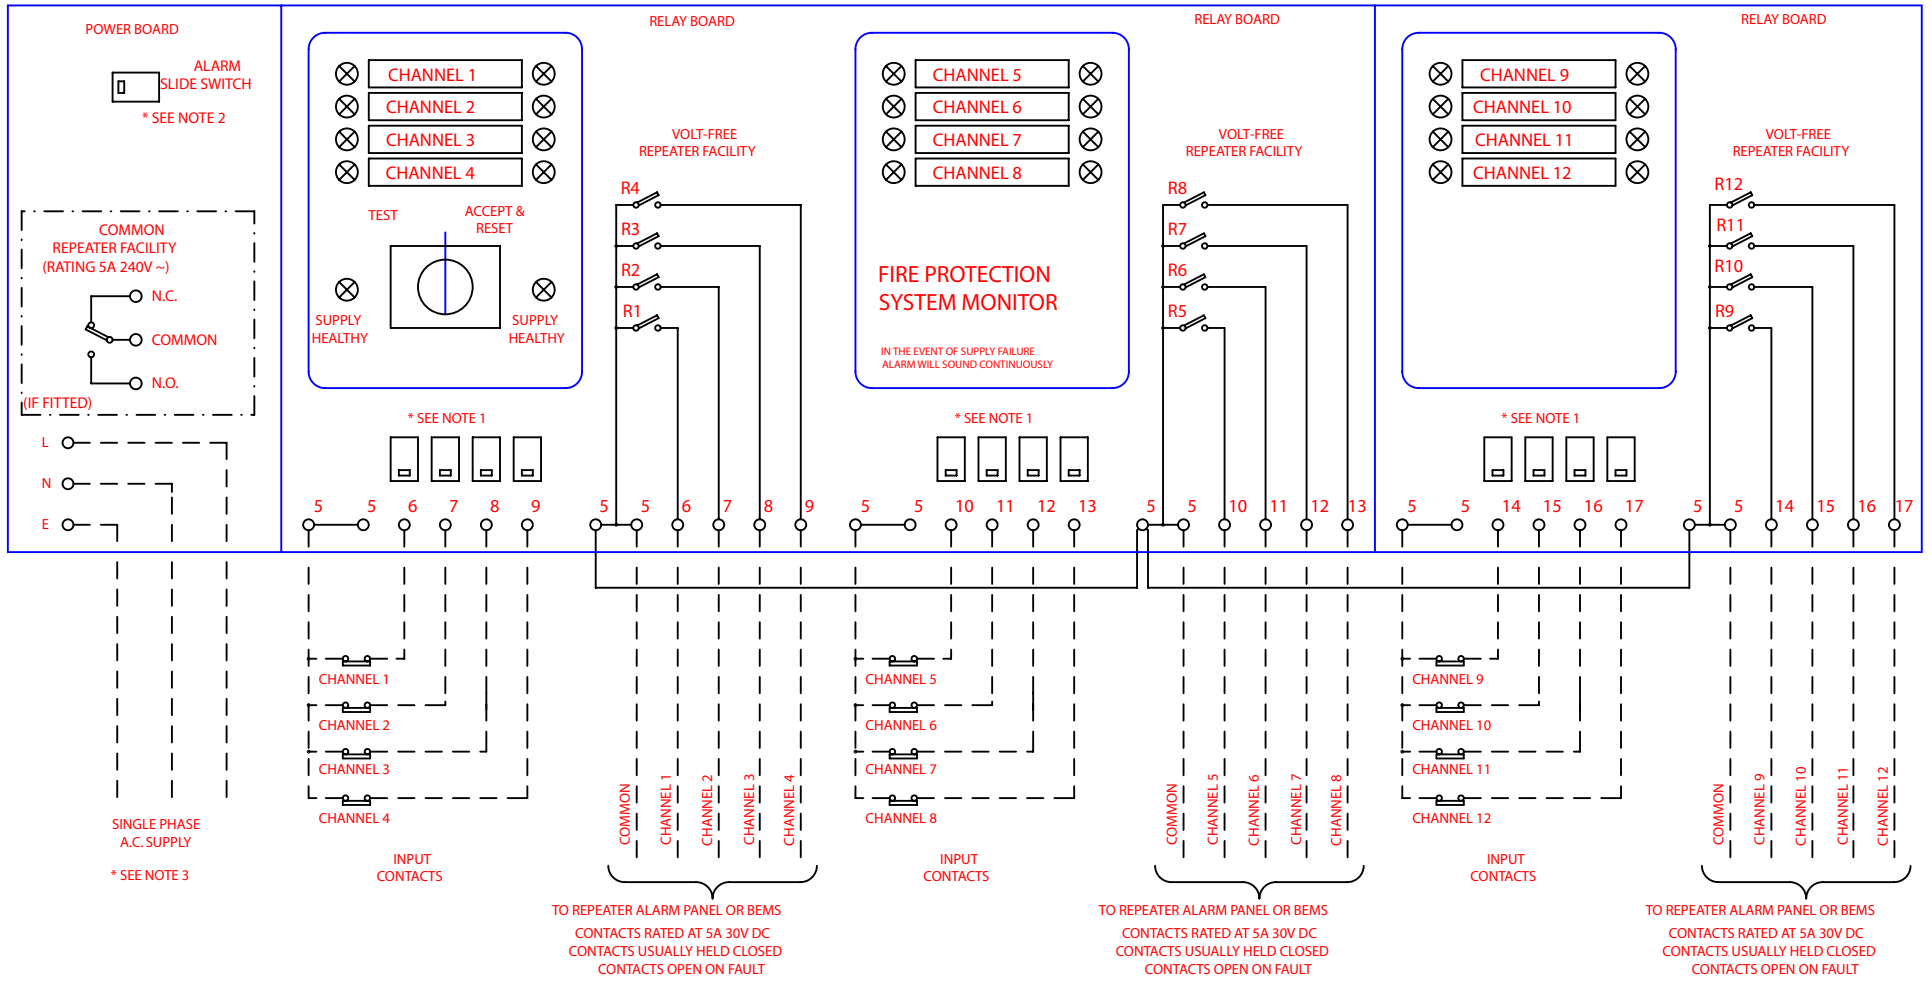

CHANNEL	1	2	3	4	5	6	7	8	9	10	11	12
PART 1	PUMPS ON DEMAND	AC PHASE FAILURE	ELECTRIC PUMP RUNNING	FIRE IN PUMP HOUSE	DIESEL CONTROLLER FAULT	DIESEL PUMP RUNNING						
PART 2	SPRINKLER PUMP SUPPLY FAIL	SPRINKLER PUMP ON DEMAND	SPRINKLER PUMP RUNNING	FIRE IN SPRINKLER PUMP ROOM	SPRINKLER PUMP FAILED	HIGH WATER LEVEL IN SPRINKLER TANK	LOW WATER LEVEL IN SPRINKLER TANK					
PART 3	No.1 PUMP ON DEMAND	No.1 PUMP RUNNING	No.1 PUMP AC PHASE REVERSAL	FIRE IN PUMP HOUSE	No.2 PUMP ON DEMAND	No.2 PUMP RUNNING	No.2 PUMP AC PHASE REVERSAL	TANK OVERFLOW	LOW WATER LEVEL	CESSATION OF ALARM		
PART 4	PUMPS ON DEMAND	AC PHASE FAILURE	ELECTRIC PUMP RUNNING	FIRE IN PUMP HOUSE	No.1 DIESEL CONTROLLER FAULT	No.1 DIESEL PUMP RUNNING	No.2 DIESEL CONTROLLER FAULT	No.2 DIESEL PUMP RUNNING				
PART 5	PUMPS ON DEMAND	AC PHASE FAILURE	ELECTRIC SET RUNNING	FIRE IN PUMP HOUSE	DIESEL CONTROLLER FAULT	DIESEL SET RUNNING	JOCKEY PUMP RUNNING	DIESEL HIGH WATER TEMPERATURE	DIESEL LOW OIL PRESSURE			
PART 6	PUMPS ON DEMAND	AC PHASE FAILURE	ELECTRIC PUMP RUNNING	FIRE IN PUMP HOUSE								
PART 7	PUMPS ON DEMAND	AC PHASE FAILURE	ELECTRIC PUMP RUNNING	FIRE IN PUMP HOUSE	DIESEL CONTROLLER FAULT	DIESEL PUMP RUNNING		MILL 1 INSTALLATION 1	MILL 1 INSTALLATION 2	MILL 2 INSTALLATION 1	MILL 2 INSTALLATION 2	
PART 8	PUMPS ON DEMAND	No.1 AC PHASE FAILURE	No.1 PUMP RUNNING	FIRE IN PUMP HOUSE	No.1 AC PHASE FAILURE	No.2 PUMP RUNNING						
PART 9	PUMPS ON DEMAND	No.1 PUMP RUNNING	No.1 CONTROLLER FAULT	FIRE IN PUMP HOUSE	No.2 PUMP RUNNING	No.2 CONTROLLER FAULT		MILL 1 INSTALLATION 1	MILL 1 INSTALLATION 2	MILL 2 INSTALLATION 1	MILL 2 INSTALLATION 2	
PART 10												
PART 11												
PART 12												
PART 13												
PART 14												
PART 15												
PART 16												
PART 17												
PART 18												
PART 19												
PART 20												
PART 21												
PART 22												
PART 23												
PART 24												

2nd ISSUE	Len Porter	ID	21/06/99
1st ISSUE	JRA	JB	09/12/96
REVISION	DRAWN BY	CHECKED BY	DATE

NORTH WEST SWITCHGEAR Ltd

MORECAMBE LANCASHIRE

12 CHANNEL ALARM PANEL AC VERSION

A3-11342