

| ITEM | DESCRIPTION |
|------|---------------------------------------|
| 1 | AMMETER |
| 2 | MAINS SUPPLY HEALTHY -INDICATING LAMP |
| 3 | PUMP ON DEMAND -INDICATING LAMP |
| 4 | PUMP RUNNING -INDICATING LAMP |
| 5 | START FAILURE -INDICATING LAMP |
| 6 | EMERGENCY START -PUSHBUTTON |
| 7 | STOP/RESET -PUSHBUTTON |
| 8 | ISOLATOR/SWITCHFUSE OPERATING HANDLE |

| Kw RATING | HEIGHT | WIDTH | DEPTH |
|-----------|--------|-------|-------|
| 5.5 | 500 | 500 | 210 |
| 7.5 | 500 | 500 | 210 |
| 11 | 500 | 500 | 210 |
| 15 | 500 | 500 | 210 |
| 18.5 | 500 | 500 | 210 |
| 22 | 500 | 500 | 210 |
| 30 | 600 | 600 | 210 |
| 37 | 600 | 600 | 210 |
| 45 | 600 | 600 | 210 |
| 55 | 600 | 600 | 210 |
| 75 | 800 | 700 | 250 |
| 90 | 800 | 800 | 210 |
| 110 | 800 | 800 | 210 |
| 132-220 | 1000 | 800 | 300 |


HEIGHT

HEIGHT
-40mm

WIDTH

WIDTH +60mm

4 OFF 10mm DIA FIXING HOLES

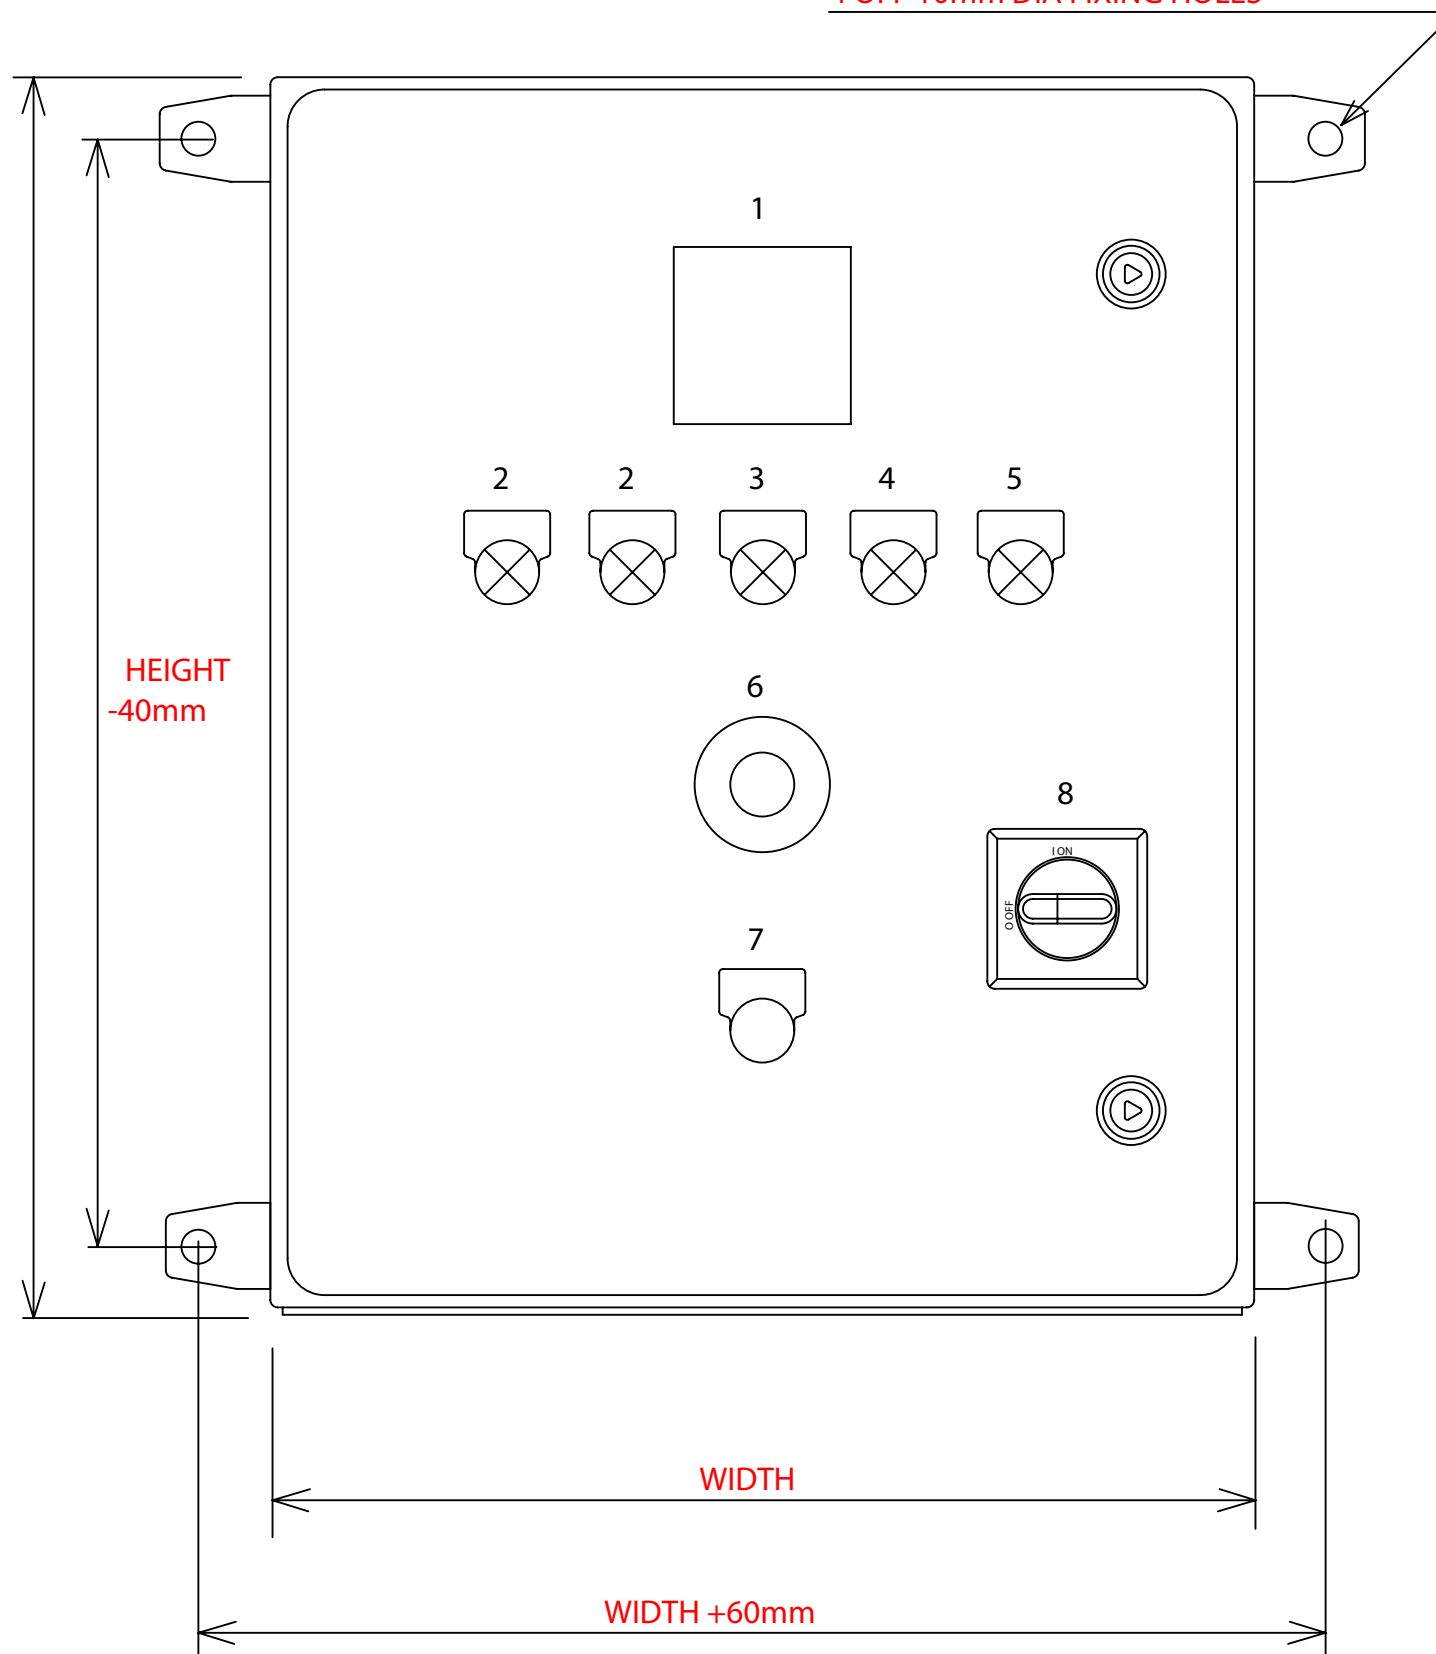

| | | | |
|-----------|------------|------------|----------|
| 1st ISSUE | Len Porter | ID | 26/06/04 |
| REVISION | DRAWN BY | CHECKED BY | DATE |

**NORTH WEST
SWITCHGEAR Ltd**

MORECAMBE LANCASHIRE

GENERAL ARRANGEMENT OF
STAR/DELTA FIRE PUMP
CONTROLLER(BS5306/EN12845
COMPLIANT) **A3-17536**