



"FIRE IN PUMP HOUSE"
FLOW SWITCH
(CLOSED AT NO FLOW)

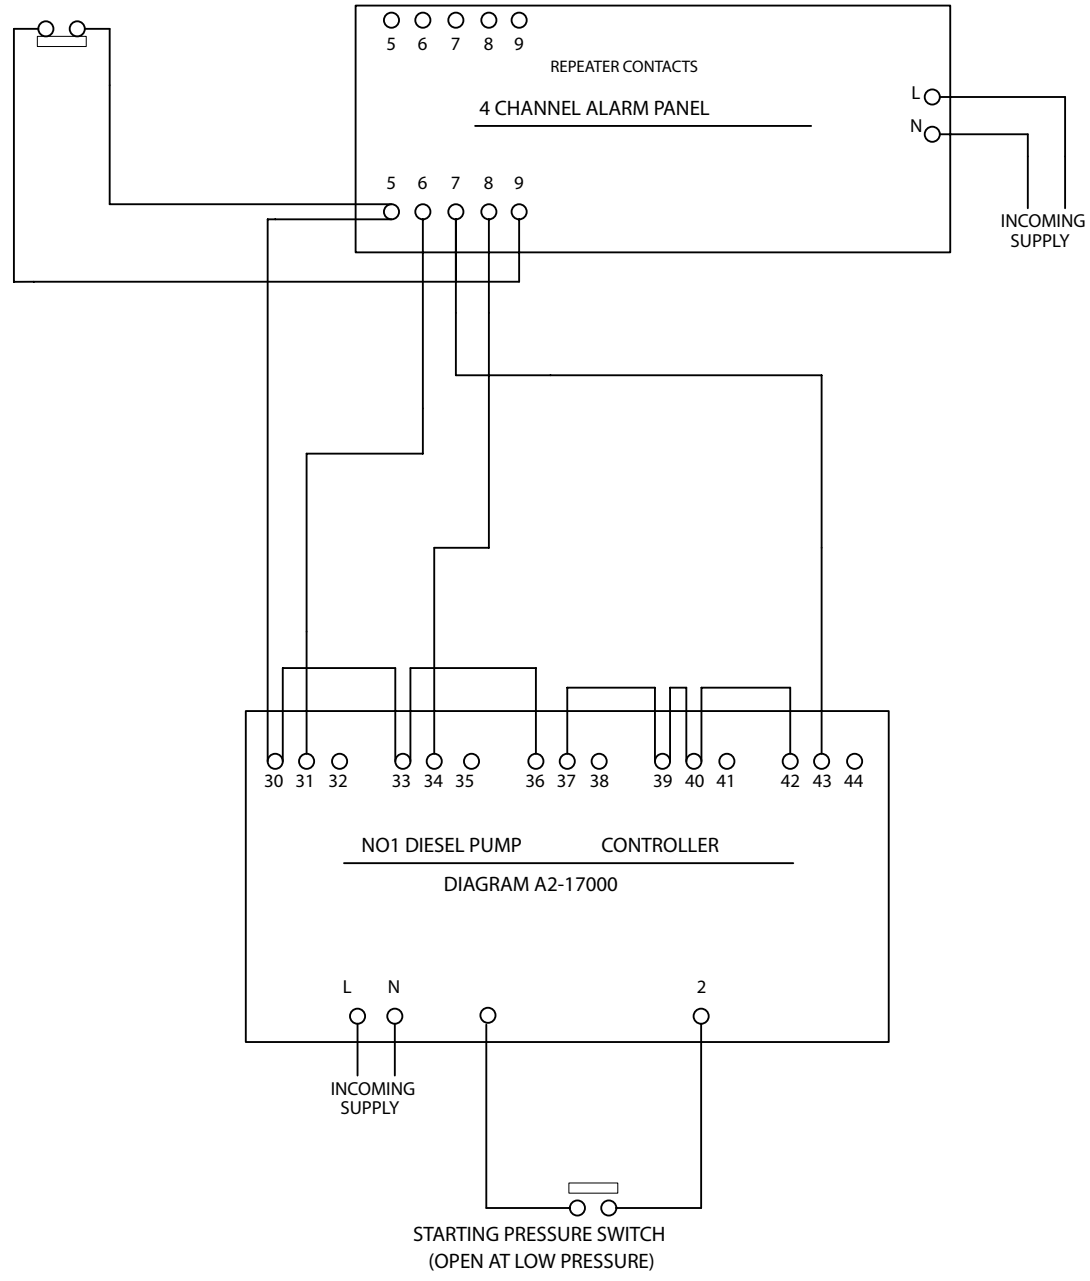

BS 5306

"FIRE IN PUMP HOUSE"
FLOW SWITCH
(CLOSED AT NO FLOW)

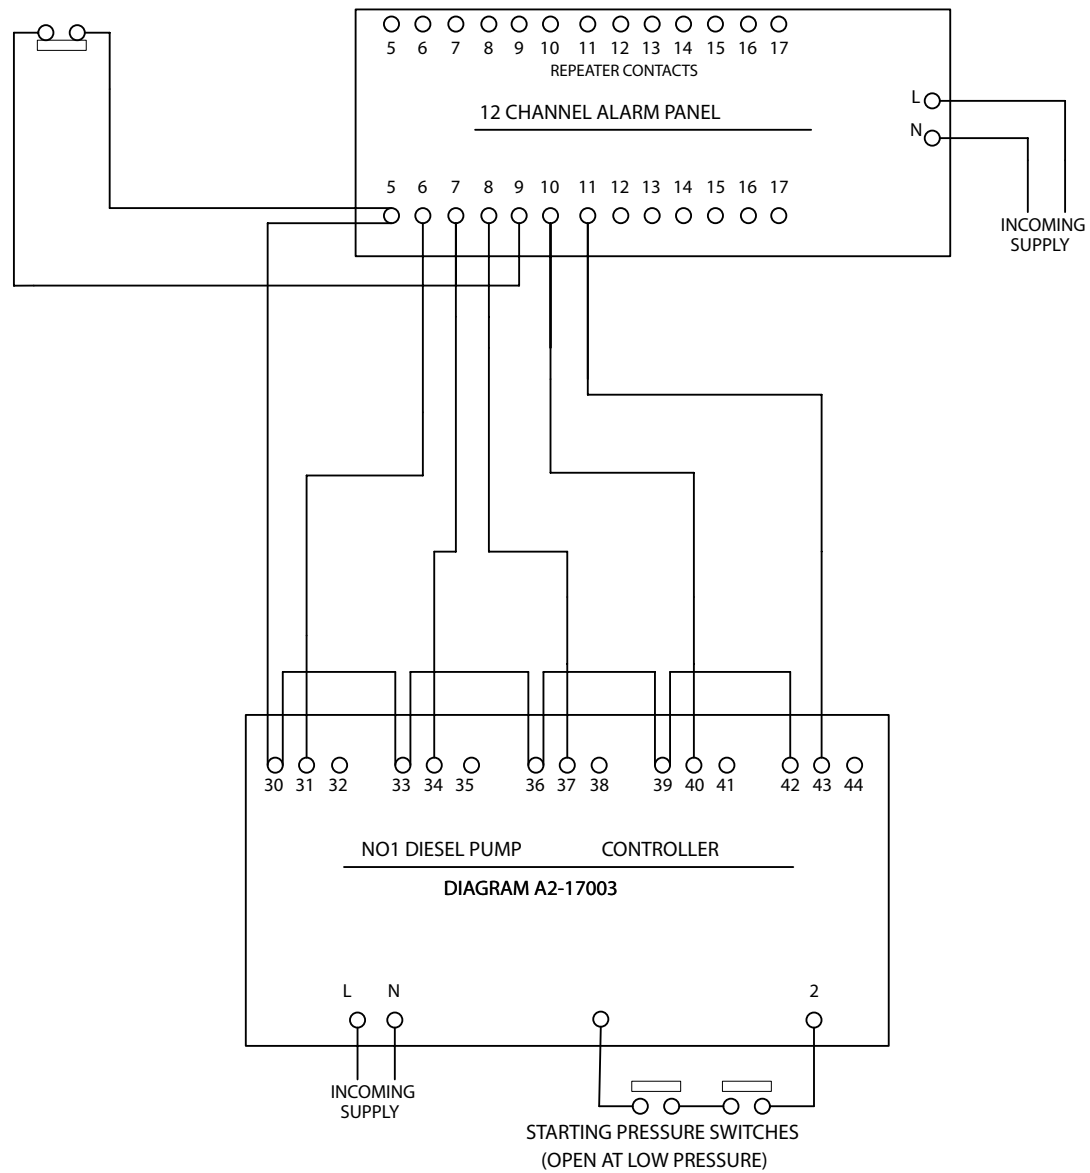

EN 12845

1st ISSUE	CT	JB	20/07/06
REVISION	DRAWN BY	CHECKED BY	DATE
NORTH WEST SWITCHGEAR Ltd			
MORECAMBE		LANCASHIRE	
CONTROLLER LINK UP DIAGRAM BS5306 and EN12845 1 DIESEL INSTALLATION			
A3-18061			