



"FIRE IN PUMP HOUSE"
FLOW SWITCH
(CLOSED AT NO FLOW)

BS 5306

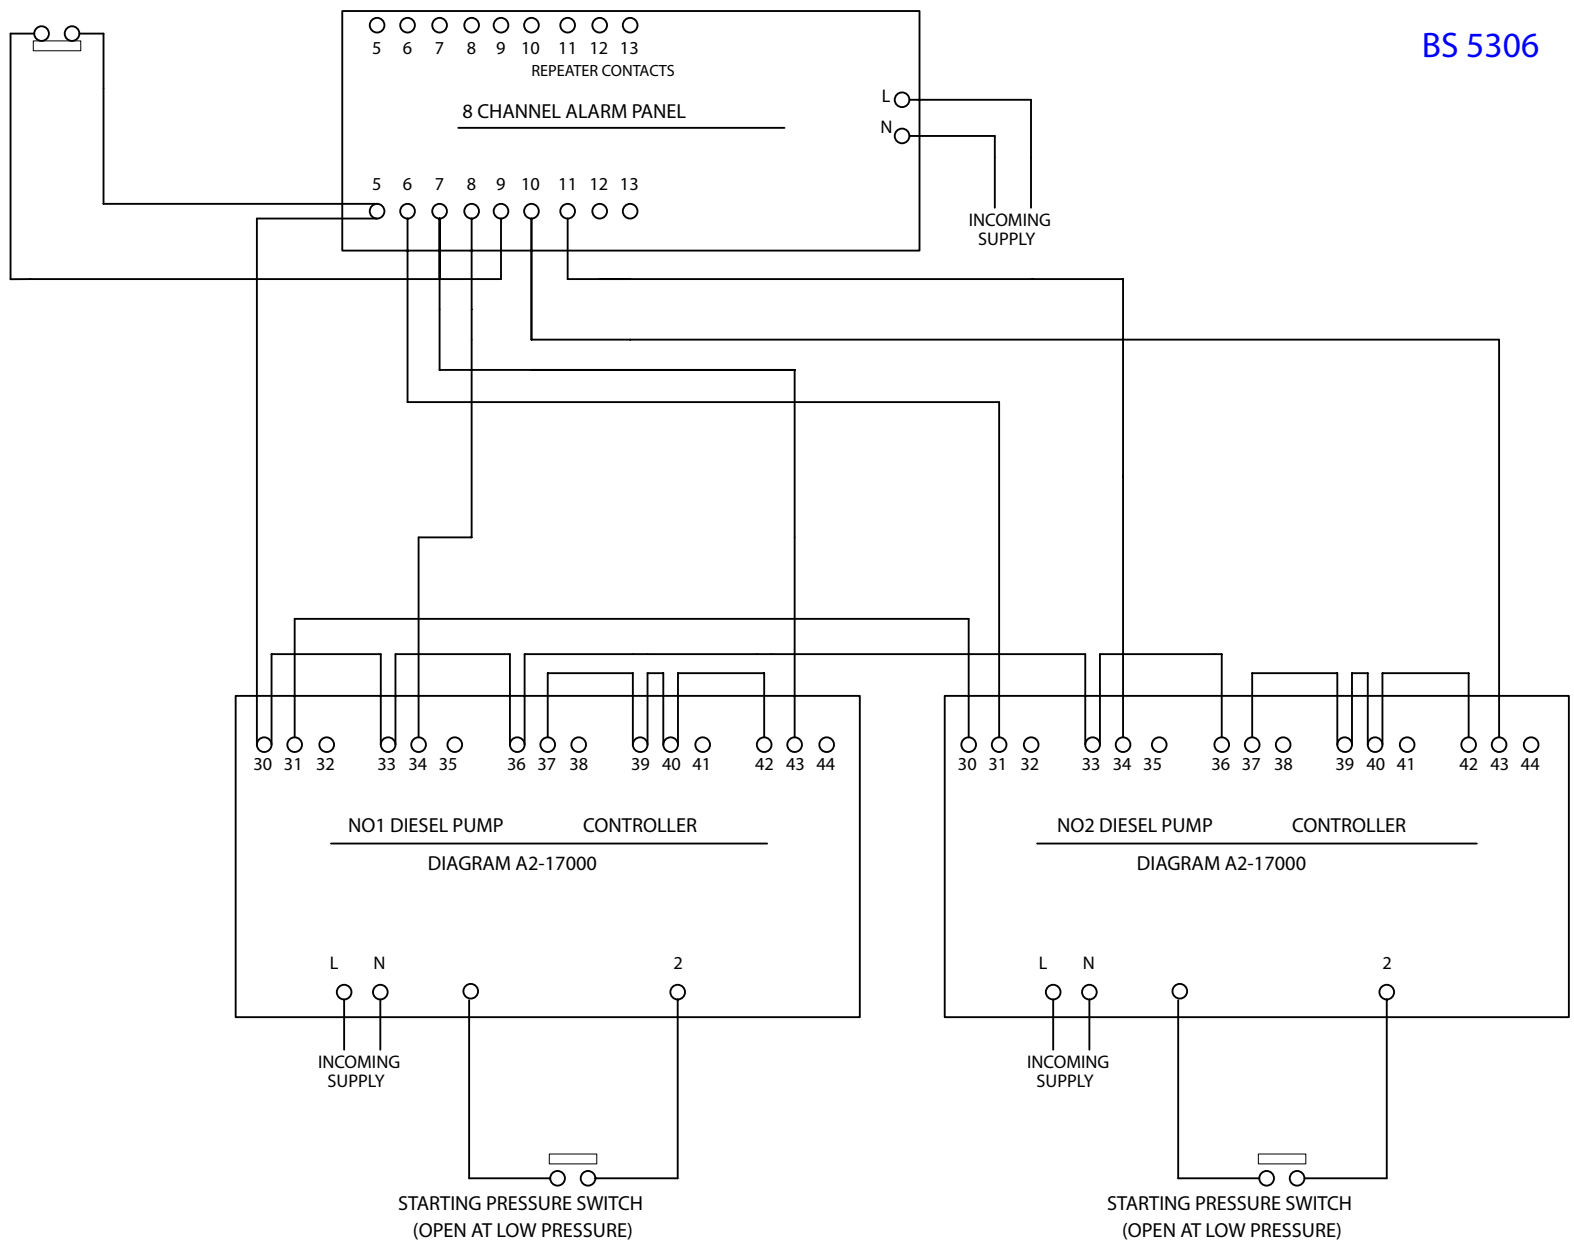

"FIRE IN PUMP HOUSE"
FLOW SWITCH
(CLOSED AT NO FLOW)

EN 12845

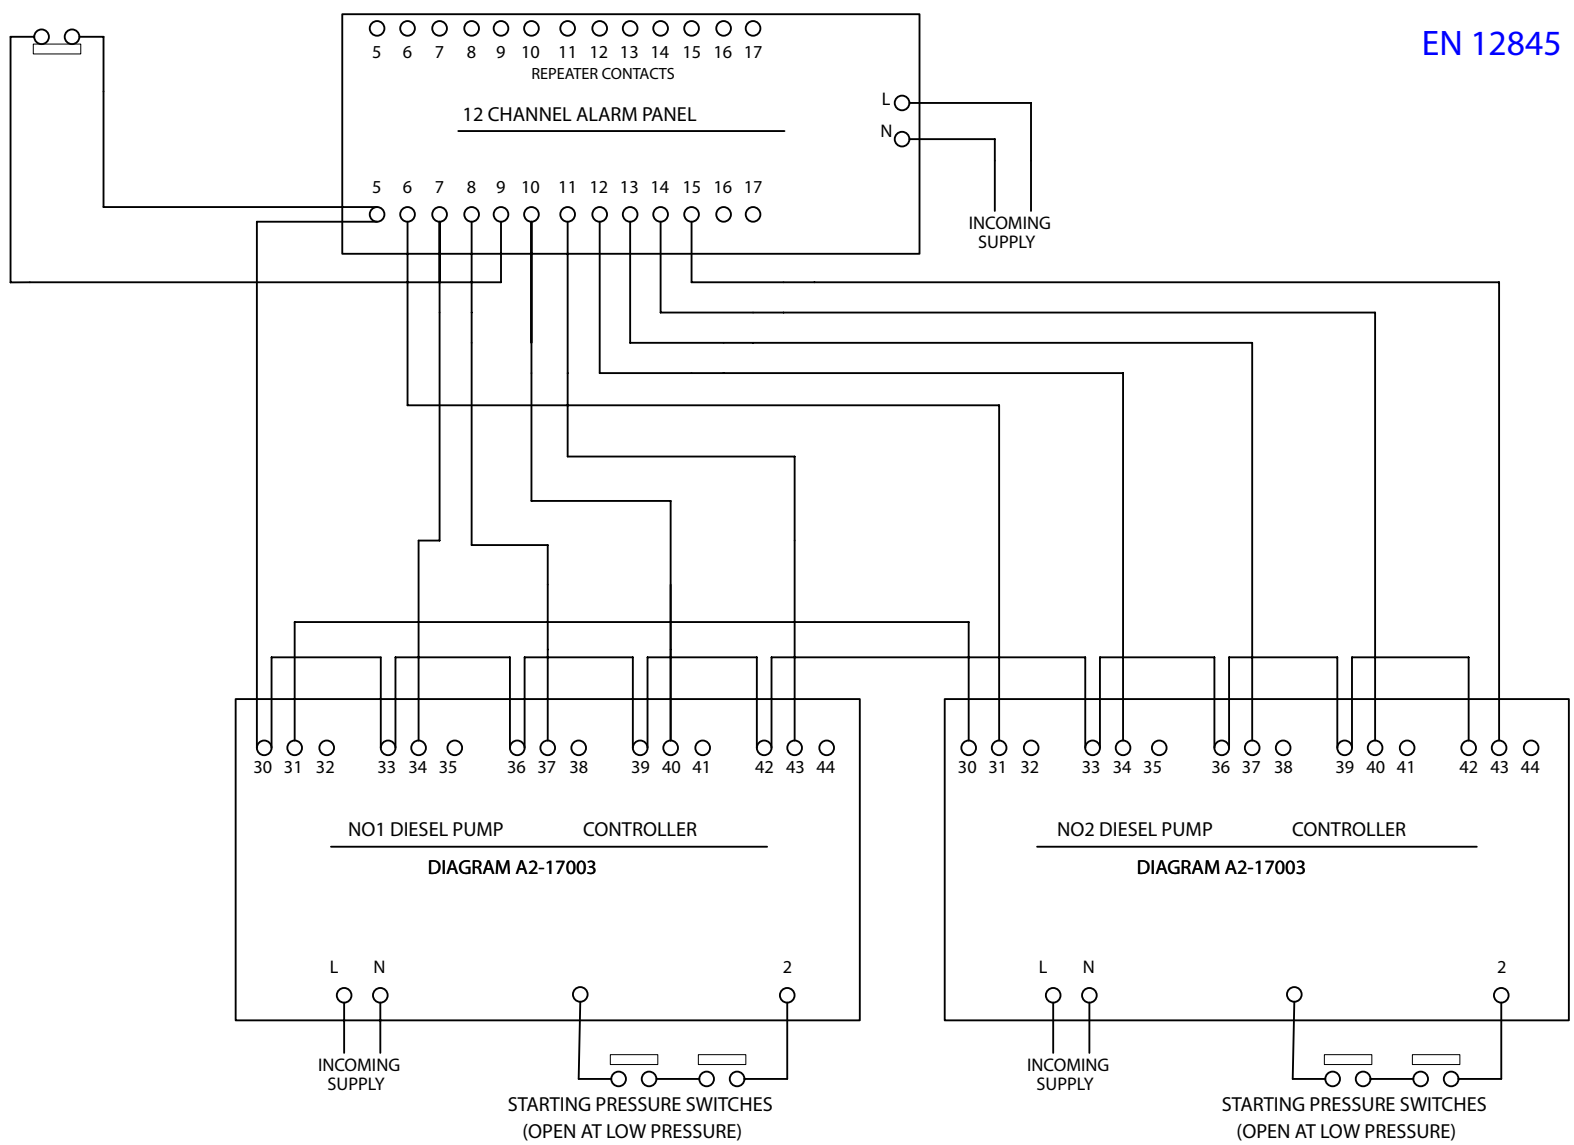

1st ISSUE	CT	JB	20/07/06
REVISION	DRAWN BY	CHECKED BY	DATE

NORTH WEST SWITCHGEAR Ltd
 MORECAMBE LANCASHIRE
 CONTROLLER LINK UP DIAGRAM
 BS5306 and EN12845
 2 DIESEL INSTALLATION
A3-18063